

# Operating Instructions for Flow Meter

**Model: KDF-9/KDG-9**



## Contents

<b>1</b>	<b>APPLICATIONS.....</b>	<b>5</b>
1.1	KDF-9 / KDG-9.....	5
1.2	KDF-9 / KDG-9 differential pressure regulator .....	5
<b>2</b>	<b>OPERATIONAL MODE AND SYSTEM DESIGN KDF-9/KDG-9.....</b>	<b>5</b>
2.1	KDF-9 / KDG-9 system design .....	5
2.2	Measuring principle for KDF-9 / KDG-9.....	5
2.3	KDF-9 / KDG-9 system design .....	5
<b>3</b>	<b>INPUT .....</b>	<b>6</b>
3.1	Measured variable:.....	6
3.2	Measuring range: .....	6
<b>4</b>	<b>ELECTRICAL OUTPUT (OPTION).....</b>	<b>7</b>
4.1	Ad-on limit switches Type RC 10/15-14-XX, Manufacturer Pepperl & Fuchs.....	7
4.2	Ad-on limit switches Type N7R**A, Manufacturer ifm electronic.....	7
<b>5</b>	<b>MEASURING ACCURACY.....</b>	<b>7</b>
5.1	Reference conditions:.....	7
5.2	Measured error .....	7
5.3	Repeatability .....	7
5.4	Influence of ambient temperature .....	7
5.5	Influence of fluid temperature.....	7
<b>6</b>	<b>CONDITIONS OF USE .....</b>	<b>7</b>
6.1	Mounting / start-up.....	8
<b>6.2</b>	<b>Ambient conditions.....</b>	<b>8</b>
6.2.1	Ambient temperature ranges.....	8
6.2.2	Storage temperature .....	8
6.2.3	Climatic category .....	8
6.2.4	Degree of protection .....	8
6.2.5	Shock resistance/vibration resistance .....	8
6.2.6	Electromagnetic compatibility.....	8
<b>6.3</b>	<b>Fluid conditions.....</b>	<b>8</b>
6.3.1	Fluid temperature ranges .....	8
6.3.2	Fluid pressure limit .....	8
6.3.3	Inlet and outlet sections .....	8
6.3.4	Physical state:.....	8
6.3.5	Pressure for gas measurement.....	8
6.3.6	Pressure loss .....	9
<b>7</b>	<b>DESIGN DETAILS .....</b>	<b>9</b>
7.1	Design/dimensions .....	9
<b>7.2</b>	<b>Design / dimensions / operating details E/F/A/B (option differential pressure regulator) 9</b>	
7.2.1	Dimension drawing KDF-9/KDG-9-...E/F with conn. 1/4" NPT (F) as regulator c/w constant outlet pressure .....	10
7.2.2	Dimension drawing KDF-9/KDG-9-...-A/B with conn. 1/4" NPT (F) as regulator c/w constant inlet pressure .....	10
<b>7.3</b>	<b>Weights: .....</b>	<b>10</b>
<b>7.4</b>	<b>Materials:.....</b>	<b>10</b>
<b>7.5</b>	<b>Process connection:.....</b>	<b>11</b>
<b>8</b>	<b>ELECTRICAL CONNECTION FOR LIMIT SWITCH (OPTION).....</b>	<b>11</b>

9	INDICATOR UNIT .....	11
10	CE MARKING .....	11
11	AVAILABLE ACCESSORIES.....	12
12	ORDER INFORMATION .....	12
13	STANDARDS AND DIRECTIVES .....	12
14	SAFETY INSTRUCTIONS .....	12
14.1	Intended use .....	12
14.2	Installation, start-up and operating personnel.....	12
15	PACKAGING, STORAGE AND SHIPMENT .....	12
16	MAINTENANCE .....	12
	ATTENTION.....	13
	REPLACING THE MEASURING CONE .....	13
	REMOVAL: .....	13
	INSTALLATION:.....	13
17	RETURNING DEVICES FOR REPAIR AND SERVICE .....	15
18	DECONTAMINATION CERTIFICATE FOR DEVICE CLEANING.....	16
19	TECHNICAL INFORMATION .....	17
20	ORDER CODES.....	17
21	DIMENSIONS.....	17
22	EU DECLARATION OF CONFORMANCE .....	18

**Manufactured and sold by:**

Kobold Messring GmbH  
Nordring 22-24  
D-65719 Hofheim  
Tel.: +49 (0)6192-2990  
Fax: +49(0)6192-23398  
E-Mail: [info.de@kobold.com](mailto:info.de@kobold.com)  
Internet: [www.kobold.com](http://www.kobold.com)



---

The instruction manuals on our website [www.kobold.com](http://www.kobold.com) are always for currently manufactured version of our products. Due to technical changes, the instruction manuals available online may not always correspond to the product version you have purchased. If you need an instruction manual that corresponds to the purchased product version, you can request it from us free of charge by email ([info.de@kobold.com](mailto:info.de@kobold.com)) in PDF format, specifying the relevant invoice number and serial number. If you wish, the operating instructions can also be sent to you by post in paper form against an applicable postage fee.

---

Operating instructions, data sheet, approvals and further information via the QR code on the device or via [www.kobold.com](http://www.kobold.com)

The devices are only to be used, maintained and serviced by persons familiar with these operating instructions and in accordance with local regulations applying to Health & Safety and prevention of accidents.

When used in machines, the measuring unit should be used only when the machines fulfil the EC machinery directive.

## 1 Applications

### 1.1 KDF-9 / KDG-9

The flow meter can be used for measuring the flow of liquid and gaseous products in pipes. It shows the current flow in volume or mass per unit time.

Applications:

Measuring the flow of liquid and gaseous products in pipes as well as dosing, superimposing, monitoring, regulating and controlling them.

### 1.2 KDF-9 / KDG-9 differential pressure regulator

The flow meter can be used for stabilizing a constant flow of liquid and gaseous products in pipes. The flow is kept constant regardless of pressure changes during product inflow for type KDF-9 / KDG-9-...E/F or of a pressure change during product outflow for type KDF-9 / KDG-9-...A/B.

Applications: Constant dosing, level measurement in open and closed vessels, N<sub>2</sub> superposition of combustible media

**Caution:** The devices should be used with the greatest possible caution to measure potentially hazardous liquids and (especially) gases. Precautionary measures must be taken to protect personnel and equipment from any potential danger or damage due to glass-tube breakage. The plant operator is fully responsible for using the devices. Where possible, we recommend the use of metal devices such as type KDS.

## 2 Operational mode and system design KDF-9/KDG-9

Float principle:

The product flows through the meter vertically from the bottom to the top. The height of the float in the measuring tube is a measure of the flow quantity. The float is in equilibrium between the buoyant force of the flowing medium and the counteracting force of gravity on the float. The measured value is displayed on the measuring-tube scale with the upper edge or the indicator edge of the float (ball).

### 2.1 KDF-9 / KDG-9 system design

The meter consists of a conical measuring tube made of glass containing a float that can move vertically. The height of the float in the measuring tube reproduces the calibrated flow quantities on the measuring tube.

### 2.2 Measuring principle for KDF-9 / KDG-9

Differential pressure regulator

The diaphragm of the controller is in a state of equilibrium when the pressure conditions are the same on both sides. The pressure on the input side is determined by the pressure of the product; the pressure on the output side is determined by the pressure drop of the setting valve of the flow meter.

If either the inlet or outlet pressure changes, the change in pressure is compensated by the built-in diaphragm valve - thus maintaining a constant set flow rate.

**Important:** The controller can only regulate inlet or outlet pressure fluctuations. Steady pressure conditions must prevail on the other side.

### 2.3 KDF-9 / KDG-9 system design

The unit consists of a KDF-9/KDG-9 variable-area flow meter, equipped with a diaphragm differential pressure flow controller. The variable-area flow meter consists of a device fitting with an integrated measuring tube made of glass that contains a vertically movable float and the valve for setting the flow rate. The differential pressure flow controller is made of stainless steel and consists of a diaphragm made of Viton or PTFE and a compensating valve made of stainless steel. For gaseous products, two versions are available:

**KDF-9/KDG-9-...A/B** for a constant inlet pressure and a variable outlet pressure

**KDF-9/KDG-9-...E/F** for a constant outlet pressure and a variable inlet pressure

For liquids, both versions can be used; however, the **KDF-9/KDG-9-...A/B** version should be preferred.

### 3 Input

#### 3.1 Measured variable:

Volume flow

#### 3.2 Measuring range:

(lower-range and upper-range values)

##### Measuring span water 20 °C KDF-9:

Smallest measuring range: 0.02-0.25 l/h water Largest measuring range: 10-100 l/h water

##### Measuring span air 20°C, 1,013 bar abs. KDG-9

Smallest measuring range: 2-20 NI/h air Largest measuring range: 300-3000 NI/h air

##### Measuring /controlling range for E/F/A/B (option diff.pressure regulator)

Span: 10-100%

##### Smallest measuring/controlling range

0.02-0.25 l/h water 2-20 NI/h air

##### Largest measuring/controlling range

10-100 l/h water 300-3000 NI/h air

##### Measuring range table

All measuring range values with fully opened valve, \* Restricted contact adjustment range / contact only adjustable as minimum contact

Measuring ranges water 20 °C					Measuring ranges air 1,013 bar abs., 20 °C				
Float st. 1.4401 (316L) / glass					Float st. 1.4401 (316L) / glass				
Range N°	Water l/h	ø Float (mm)	ø Valve seat (mm)	Press. loss (mbar)	Range N°	air l/h	ø Float (mm)	ø Valve seat (mm)	Press. loss (mbar)
91	0.02-0.25	glass	2.8	2	88	2-20	glass	2.8	1
92	0.08-0.7	glass	2.8	3	89	4-40	glass	2.8	2
79	0.1-1	1.4401	2.8	2	70	5-50	1.4401	2.8	1
80	0.25-2.5	1.4401	2.8	3	71	10-100	1.4401	2.8	2
81	1.0-10	1.4401	2.8	3	90	12-120	glass	2.8	2
82	1.5-16	1.4401	2.8	5	72	25-250	1.4401	2.8	2
83	2.5-25	1.4401	2.8	5	73	30-350	1.4401	2.8	2
84	4-40	1.4401	2.8	5	74	50-450	1.4401	2.8	3
85	5-65	1.4401	2.8	5	75	60-800	1.4401	2.8	3
86	6-63	1.4401	2.8	6	76	120-1200	1.4401	2.8	3
87	10-100	1.4401	2.8	6	77	200-2000	1.4401	2.8	3
					78	300-3000	1.4401	2.8	3

## 4 Electrical output (option)

1 inductive limit switch  
Mono- or bistable

### 4.1 Ad-on limit switches Type RC 10/15-14-XX, Manufacturer Pepperl & Fuchs

Monostable	Type	RC 10/15-14-N0
Bistable	Type	RC 10/15-14-N3

### 4.2 Ad-on limit switches Type N7R\*\*A, Manufacturer ifm electronic

Monostable	Typ	N7R28A (Inside diameter 10mm) N7R30A (Inside diameter 15mm)
------------	-----	--

Bistable	Typ	N7R29A (Inside diameter 10mm) N7R31A (Inside diameter 15mm)
----------	-----	--

## 5 Measuring accuracy

### 5.1 Reference conditions:

Water 20°C (air 20°C; 1, 013 bar abs)

### 5.2 Measured error

(Liquid/Gas):  $\pm 3\%$   $q_G=50\%$  acc.. VDE/VDI 3513 page 2

E/F/A/B (option diff.pressure regulator):  $\pm 3, 5\%$  /  $\pm 5\%$  FS within 10-100% of the range

### 5.3 Repeatability

(Liquid/Gas)  $\pm 1.0\%$  FS,

E/F/A/B (option differential pressure regulator):  $\pm 1, 5\%$  /  $\pm 2, 5\%$  FS within 10-100% of the range

### 5.4 Influence of ambient temperature

none

### 5.5 Influence of fluid temperature

Deviations in fluid temperature from the temperature observed during calibration can result in a proportional display fault because of the corresponding change in density and viscosity.

## 6 Conditions of use

The VDI/VDE guidelines must be observed.

The devices can be used for:

- liquid products that are sufficiently free-flowing, are free of solids, do not bond or do not tend to settle.
- gases with linear flow behavior and an adequate inlet pressure.

V/N(option differential pressure regulator)

The minimum differential inlet and outlet pressures must be 350 mbar.

**Please refer to the instructions for potentially hazardous products in Section 1.2.**

## 6.1 Mounting / start-up

When starting up the flowmeter, the following points must be observed:

- The variable-area flow meter must be installed perpendicularly (direction of flow from the bottom to the top).
- Take special care to install glass-tube devices free from strain.
- The size of the product line to be connected must be identical to the size of the device connection.
- All instruments are shipped with the valve installed at the inlet. By turning the glass tube resp. the fitting, the valve also can be installed at the outlet.
- **E/F/A/B** (option diff.pressure regulator): When using gases, the version for a constant inlet pressure with "valve at the top" and for a constant counter pressure with "valve at the bottom" should be used. If liquids are involved, the position of the valve does not have any impact on the function of the meter.
- Slowly open the shut-off valve upstream and downstream of the flowmeter.
- When measuring liquids, vent the pipes carefully.
- When measuring gases, increase pressure slowly.
- Void float impact (e.g. caused by solenoid valves), as this is likely to damage the measuring section or float.

## 6.2 Ambient conditions

### 6.2.1 Ambient temperature ranges

-20°C to +100°C (with limit switch -20° +70°C) (**risk of breakage due to frost**)

### 6.2.2 Storage temperature

-20°C to +100°C

### 6.2.3 Climatic category

Weather-protected and/or unheated locations

### 6.2.4 Degree of protection

IP65 (EN60529)

### 6.2.5 Shock resistance/vibration resistance

The meter should be protected from shocks and vibrations, which could cause damage.

### 6.2.6 Electromagnetic compatibility

Built in limit switch:

acc. NAMUR recommendation NE 21

Product standard: EN 60947-5-2: 2004

## 6.3 Fluid conditions

### 6.3.1 Fluid temperature ranges

without limit switch -20°C to + 100°C

with limit switch -20°C to + 70°C (**risk of breakage due to frost**)

### 6.3.2 Fluid pressure limit

16 bar (at 20 degrees Celsius)

#### **Important:**

All pressure values are for non-hazardous liquids and for devices installed free from strain.

For **E/F/A/B**, (option differential pressure regulator) the maximum unilateral pressure resistance of the diaphragm is **7 bar**.

### 6.3.3 Inlet and outlet sections

Inlet and outlet sections are not required for a linear flow profile of the fluid.

### 6.3.4 Physical state:

Liquid or gaseous

### 6.3.5 Pressure for gas measurement



The measured values only apply to the calibrated fluid data stated on the scale. Any change or deviation in pressure will cause a display fault.

### 6.3.6 Pressure loss

**Depends on the measuring range.** (see measuring range tables in Section 3.2)


## 7 Design details

### 7.1 Design/dimensions

The meter consists of a conical measuring tube made of borosilicate glass with a vertically movable float made of stainless steel or glass. The measuring tube is installed in the device fitting and does have a horizontal connection on the rear.

The standard version of the device is equipped with an adjusting valve at the outlet

#### KDF-9/KDG-9 ( dimensions in mm )

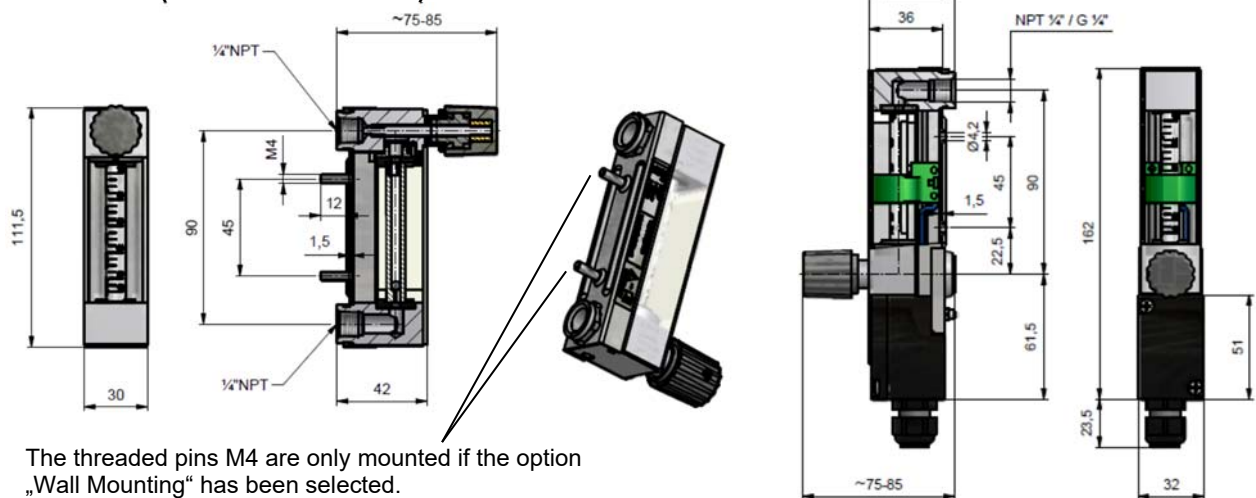

### 7.2 Design / dimensions / operating details E/F/A/B (option differential pressure regulator)

Differential pressure regulators are used to achieve constant flow values at variable inlet and outlet pressures.

➔ Differential pressure regulators are not pressure reduction valves

The measuring device consists of variable area flowmeter with control valve and mounted differential pressure regulator.


The flow amount will be adjusted via the integrated adjusting valve.

The max.one side pressure resistance of the regulator membrane is 7 bar. If the operating pressure exceeds 7 bar, the control valve must not be fully closed as this leads into overstressing the membrane.


#### IMPORTANT OPERATION DETAILS

- ➔ The installation of any valve before the inlet and outlet of the instrument shall be avoided
- ➔ Initial operation / start up of the process only with opened control valve
- ➔ When operating any gas the inlet pressure shall be increased slowly to avoid strong pressure peaks
- ➔ Any operation of the instrument trough any solenoid valve shall be avoided, this will prevent the float will be thrown upwards heavily.
- ➔ For the operation of the regulator minimum inlet pressure are required.
  - Regulator with constant outlet pressure: 350 mbar
  - Regulator with constant inlet pressure: 350 mbar

**7.2.1 Dimension drawing KDF-9/KDG-9...E/F with conn. 1/4" NPT (F) as regulator c/w constant outlet pressure**

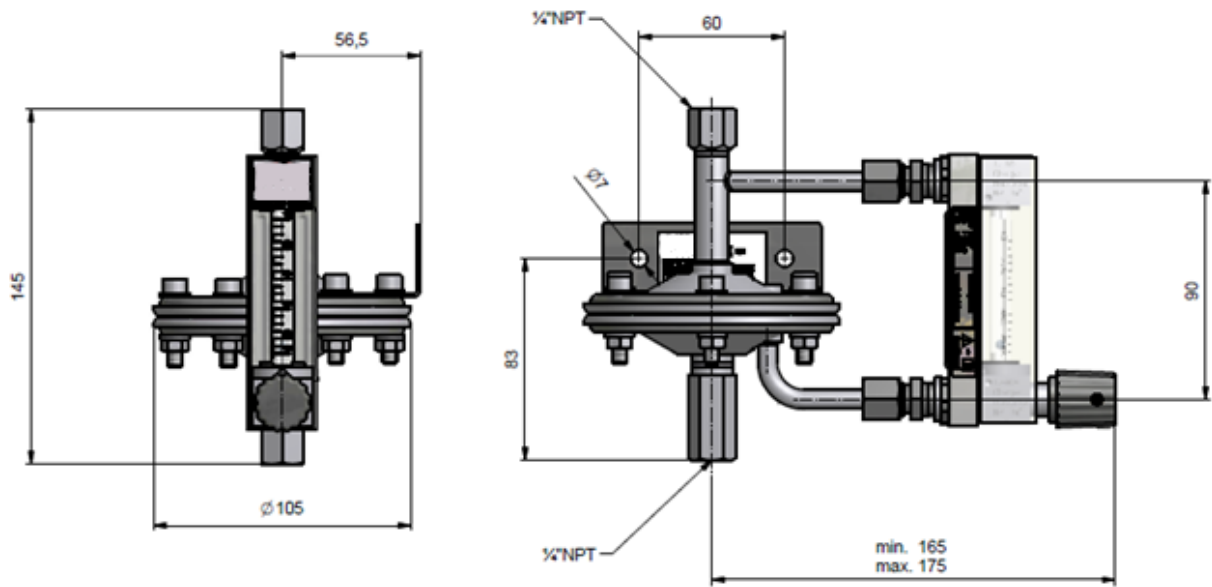

**7.2.2 Dimension drawing KDF-9/KDG-9...-A/B with conn. 1/4" NPT (F) as regulator c/w constant inlet pressure**

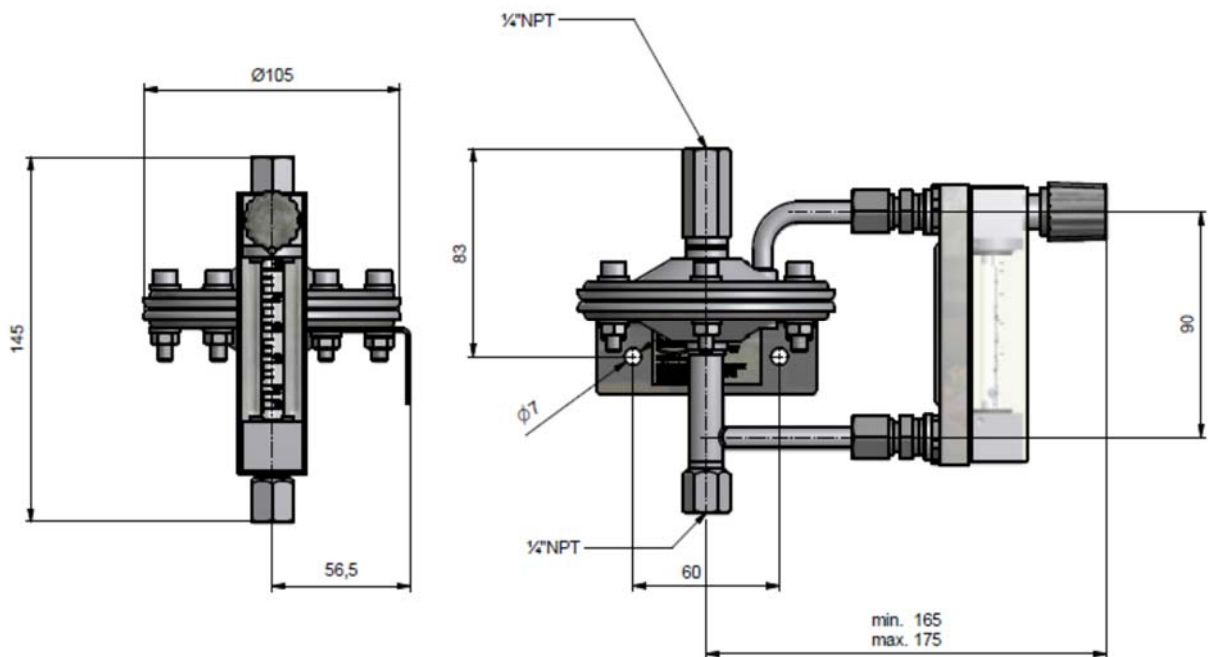

**7.3 Weights:**

KDF-9/KDG-9: 0.4 kg, KDF-9/KDG-9...E/F/A/B: 0.8 kg

**7.4 Materials:**

Fitting, connections, setting valve: 1.4404 (316L)

Float 1.4401 / glass

Seals measuring tube: viton, FFKM (option)

Valve: PTFE, Hoses: PVC

E/A (option differential pressure regulator)

Controller/control pipes: 1.4301

## 7.5 Process connection:


NPT 1/4" (F)

Special connections: Ermeto, Swagelok, G 1/4", Hose connector 8 mm

**Important:** Other connections are available as special versions

## 8 Electrical connection for limit switch (option)

with cable end length of 2 m

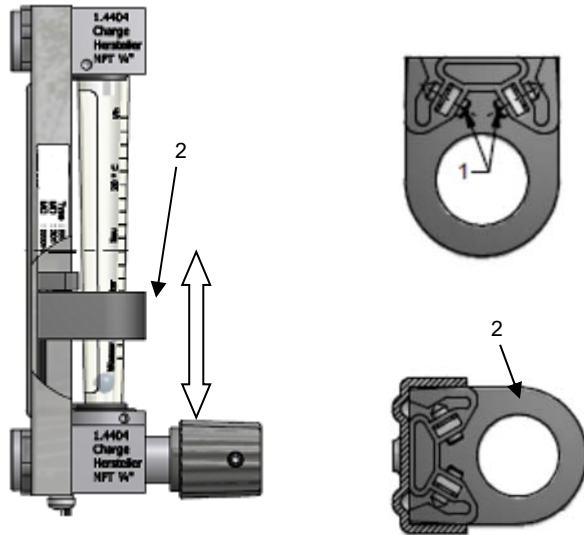

The limit switch (ring form) can be adjusted alongside of the measuring tube. It is fixed via two screws (1) at the back wall of the instrument.


### Adjusting of the contact:

- unlock the fixing screws (1)
- move contact (2) to bottom or top
- lock fixing screws (1)

### ATTENTION: (limited switching range)

Measuring ranges 78, 78 and all ranges with glass float cannot be equipped with contact. For the measuring tubes N° 77 and 86 the contact cannot be moved to the max. flow range.

Wiring diagram for limit switch

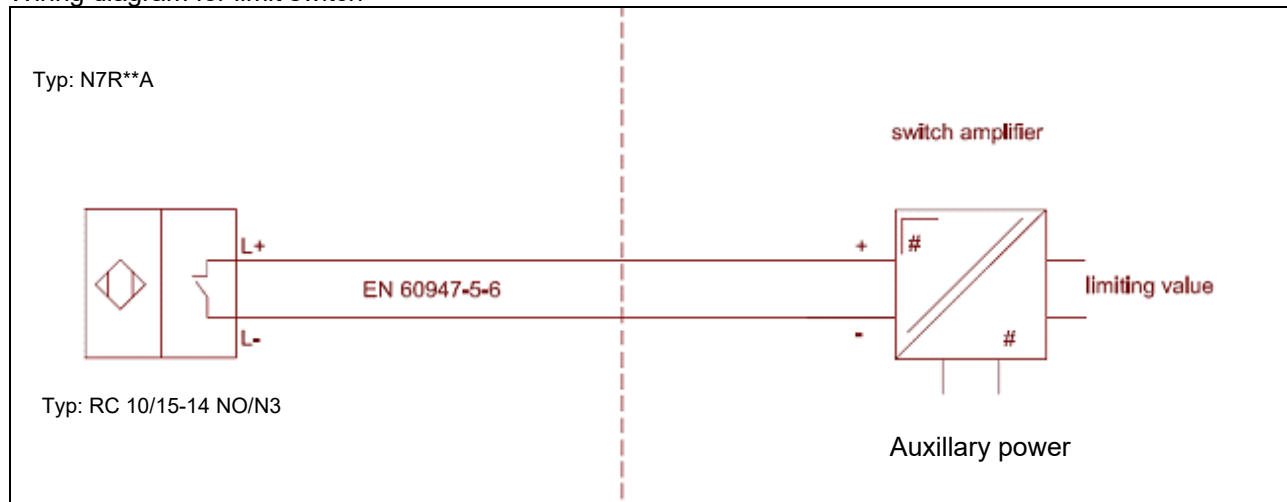

## 9 Indicator unit

Direct indication via the position of the float in the measuring tube

## 10 CE marking

The measuring system meets the statutory requirements of the following EU directives: Electromagnetic Compatibility (EMC) Directive 2014/30/EU.

With respect to the Pressure Equipment Directive 2014/68/EU, the devices fall within the scope of application of Article 4, Section 3, and need no CE mark in accordance with this directive.

Kobold Messring confirms compliance with the directives by attaching the CE mark.

## **11 Available accessories**

1 inductive limit switch ; mono-stable or bi-stable  
Special connections

## **12 Order information**

Please include the following information in your order: Product data, (specific weight, temperature, pressure, viscosity) material design, connection size, measuring range, desired accessories, required approvals and material certificates.

## **13 Standards and directives**

Measuring range rated and converted to other products according to VDE/VDI guidelines 3513  
Directive 2014/68/EU (Pressure Equipment Directive)

### **For the electrical sensor**

EN 60079-0 General regulations  
EN 60079-11 intrinsically safeness  
Guideline 2014/30/EU (EMC guideline)  
NAMUR recommendation NE 21  
EN 60529 – Degrees of protection through housing (IP code)  
EN 61010-1 – Safety requirements for electrical measuring, control and laboratory devices

## **14 Safety instructions**

### **14.1 Intended use**

The KDF-9/KDG-9 variable-area flow meter may be used only for flow measurements of fluid and gaseous media. The manufacturer shall not be liable for damage that may result from improper or unintended use.

When dealing with an aggressive medium, clarify the material durability of all wetted parts.

### **14.2 Installation, start-up and operating personnel**

Only trained specialists authorized by the system operator may carry out the installation, electrical installations, start-up, maintenance and operation. They must read and understand the operating manual and follow its instructions.

Basically, follow the conditions and provisions applicable in your country.

## **15 Packaging, storage and shipment**

Carefully unpack the device to avoid damaging it. With the help of the delivery note enclosed in the packaging, check whether all technically relevant data coincide with your requirements.

Storage and installation must be done in a clean and dry room so that contamination – especially of the interior of the fitting – is avoided. Follow the limit values for ambient temperature.

When transporting the device to a remote mounting location, we recommend that you reuse the factory-issued packaging and the transport protection.

## **16 Maintenance**

If you use the meter in the intended manner special maintenance is not necessary. However, the variable area flow meter should be checked in the context of the routine maintenance of the facility and the pipelines. You have to eighth especially for dirt, corrosion denudation, mechanical wear as well damage at the glass cone. We recommend checking the meter once a year.

In the recurrent pressure test of the system, the maximum allowed pressure test PT (see name plate) must not be exceeded.

### Attention

If cleaning of the float or of the measuring cone is necessary due to contamination, please note following items:

- Before removing a device, make sure that the pipe line is empty (no product residues) depressurized and cooled.
- For devices that are used to measure corrosive or hazardous media, appropriate security precautions have to be taken regarding any remaining liquid in the measuring unit
- Avoid electrostatic charging of surfaces when cleaning non-conductive surfaces (e.g. protective hood)
- Having dismantled the device, dirt on the inside of glass measuring cones can be gently cleaned with a brush and appropriate media.
- When assembling and reinstalling the system always new gaskets have to be used.


### Replacing the measuring cone


#### Removal:

- Close valve in front and behind the unit
- Close needle valve of the device
- Shift protective cover upwards and remove to the front.
- By turning the adjusting ring at the unit base counterclockwise the measuring glass can be loosened and removed.

#### Installation:

- Installation has to be carried out in reverse order
- The measuring glass is fixed by clamping the adjusting ring on the unit base hand tightened
- With a 3 mm pin the clamping ring is fixed by **4, max. 5 120° turns** clockwise.
- The torque should be max 2.8 to 3 Nm.
- Caution! To avoid breaking of the glass flow tube it has to be installed centrally between the seals.
- Before re-commissioning the tightness of the measuring device has to be checked by suitable means.

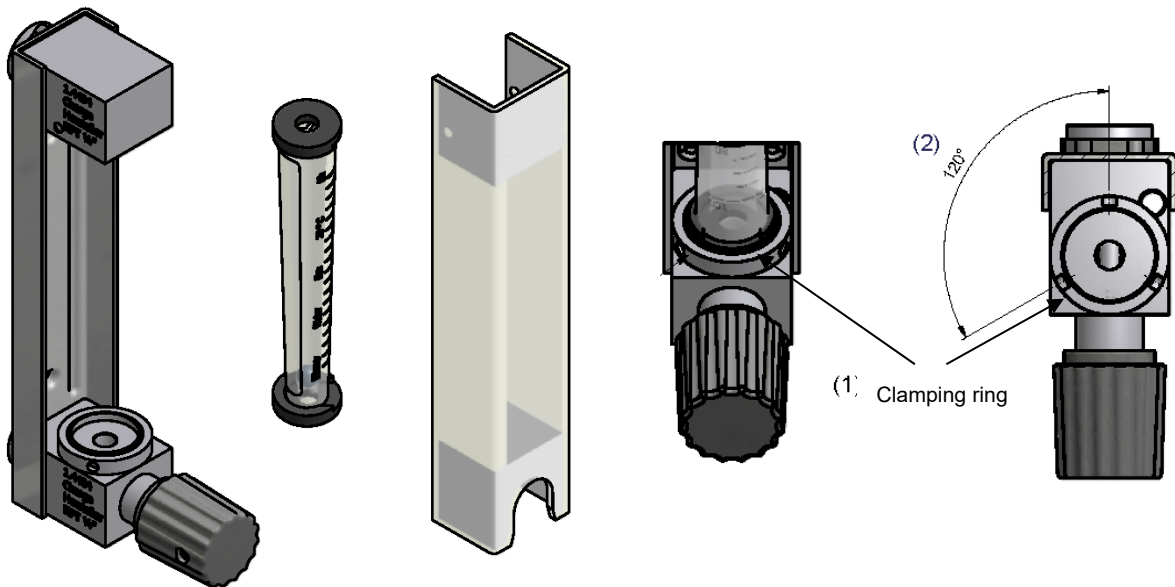

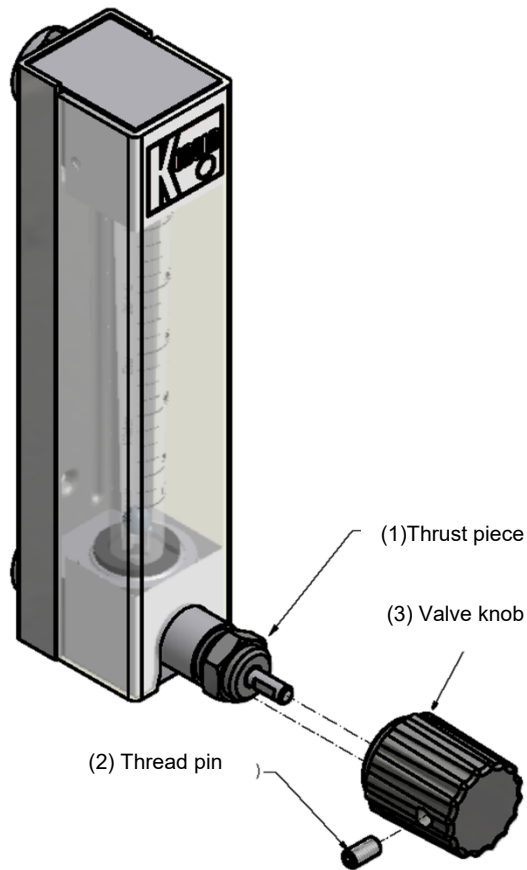

### Attention

The shaft packing of the valve must be readjusted during the life cycle. This requires tightening of the thrust piece (1)

Loosen thread pin (2) M4x8 with hexagon 2mm and remove valve knob (3).

Tighten thrust piece (1) SW14 with a torque of 3, 8 Nm - 4, 0 Nm

### Caution

Valves that have not been operated for a long time may require a higher operating torque.



## **17 Returning devices for repair and service**

Note:

In accordance with the applicable German waste disposal legislation, the owner/client is responsible for the disposal of special waste and hazardous materials. Consequently, all devices sent to us for repair must be free of any hazardous materials. This also applies to possible hollow spaces and fissures in the devices.

If repair is necessary, confirm the above-mentioned requirement in writing (please use the form in the Appendix).

If hazardous materials remain in or on the device after it has been returned, Kobold Messring is authorized to remove them at the client's expense without further inquiry.

## 18 Decontamination certificate for device cleaning

Company: .....

City: .....

Department: .....

Name: .....

Tel: .....

This variable-area flowmeter

Type KDF-9/KDG-9-.....

was operated using the measured medium.....

Since this measured medium is dangerous in water\*/poisonous\*/corrosive\*/flammable\*,

we have:

- checked that all hollow spaces of the device are free of these materials\*
- neutralized and flushed all hollow spaces of the device\*

\*cross out what is not applicable.

We hereby confirm that in resending the device no danger to persons or the environment is posed by the residual measured substance.

Date: .....

Name: .....

Signature: .....

Stamp



## **19 Technical Information**

Operating instructions, data sheet, approvals and further information via the QR code on the device or via [www.kobold.com](http://www.kobold.com)

## **20 Order Codes**

Operating instructions, data sheet, approvals and further information via the QR code on the device or via [www.kobold.com](http://www.kobold.com)

## **21 Dimensions**

Operating instructions, data sheet, approvals and further information via the QR code on the device or via [www.kobold.com](http://www.kobold.com)

## 22 EU Declaration of conformance

We, KOBOLD Messring GmbH, Nordring 22-24, 65719 Hofheim, Germany, declare under our sole responsibility that the product:

**Flow Meter  
N7R\*\*A**

**Model: KDF-9/KDG-9-...** with limit switches Type **RC 10/15-14-XX** or Type

to which this declaration relates is in conformity with the following EU directives stated below:

**2014/30/EU  
2011/65/EU**

**EMC Directive  
RoHS** (category 9)

Also, the following standards are fulfilled:

**EN 61000-6-2:2011** Electromagnetic compatibility (EMC) - Part 6-2: Generic standards - Immunity for industrial environments

**EN 61000-6-3:2012** Electromagnetic compatibility (EMC) - Part 6-3: Generic standards - Emission standard for residential, commercial and light-industrial environments

**EN 55011:2011** Industrial, scientific and medical equipment - Radio-frequency disturbance characteristics - Limits and methods of measurement

**EN 61326-1:2011** Electrical equipment for measurement, control and laboratory use - EMC requirements - Part 1: General requirements

**EN 50581:2012** Technical documentation for the assessment of electrical and electronic products with respect to the restriction of hazardous substances

Hofheim, 22 Dec. 2023



H. Volz  
General Manager



J. Burke  
Compliance Manager